



Beyond  TM

Cast Resin
Transformer



LS ELECTRIC


High quality



High efficiency



Eco-friendly

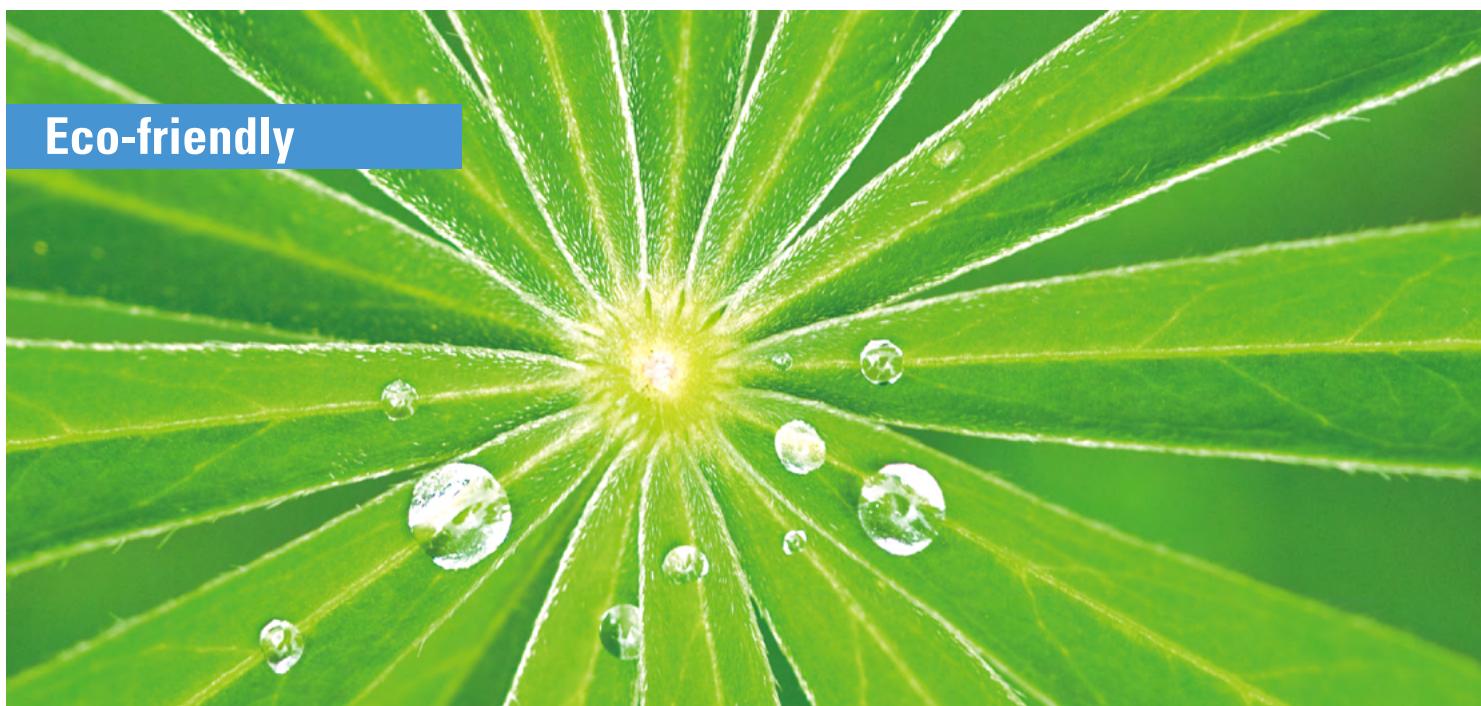



CAST RESIN TRANSFORMER

Close than you imagine

Where there is light brightening and moving the world, from homes to offices, from factories to airports, power is supplied everywhere, with LS ELECTRIC by the side. We are bringing you the light, to wherever you are.

Contents

Feature	4
Application fields	6
Components	8
Manufacturing and quality management	10
Standard specification	11
Metasol technical data	12
Installation and operation conditions	13

Feature

Metasol **CAST RESIN TRANSFORMER**

Our transformer is in compliance with IEC standard, and its compact design is the strength compared to Metasol T1 and T2 of same specification with lower initial purchasing cost. It offers various options to help create the right solution suitable for each condition.



"We have an authorized power test technology center, operating ISO 9001-certified quality assurance system, and performing tests according to IEC 60076 or international standards."



This is a compact and high-efficiency product made with cutting-edge technology that is easy to maintain, excellent in short circuit strength, humidity resistance and non-combustibility, and also suitable for equipment with severe load variations such as electric-train power supply systems, etc.

Short circuit strength

The coils are vacuum-cast with epoxy resin with excellent electrical and mechanical strength to be strong against short circuit accidents.

Easy to maintain

This doesn't need insulation oil exchange or separate fire-fighting equipment.

Overload tolerance

LS Cast Resin Transformer has an excellent overload tolerance compared to the oil immersed type transformer to be used normally even at a temporary overload state.

Suitable for supplying power to equipment with rapidly changing loads

Suitable for equipment such as electric-train power supply equipment and rolling equipment.

Humidity resistance

The high voltage coils are vacuum-molded to prevent moisture ingress during long-term storage so that it is possible to input power without drying.

Non-combustibility

LS Cast Resin Transformer uses non-combustible epoxy resin to prevent fires due to electric arcs and has self-extinguishability.

Impulse voltage strength

This has excellent impulse voltage strength owing to the outstanding insulation performance of epoxy resin and the design of split winding type.

Reduction of environmental impact

We obtain the certification F1,E2,C1 from CESI(italia) and E3,C3 from FILK(Korea), according to IEC 60076-11.

Overload capability

LS Cast Resin Transformer has an excellent overload capability compared to the oil immersed type transformer to be used normally even at a temporary overload site

Application fields

"LS Cast Resin Transformers can be used in various fields.
Here are a some possible applications."



1. Semiconductor factory, LCD factory
2. High-rise building, Apartment
3. Subway, Express railway
4. Thermal power plant, Transformer station, Petrochemical plant
5. Hospital
6. Solar photovoltaic
7. Car factory, Rolling factory
8. Airport, Port
9. Hydro-power plant, Water treatment facility

Places requiring high reliability

Nuclear power plant, semiconductor factory, car factory, petrochemical factory, drilling ship, dock crane, Rolling factory, international airport, thermal power plant, transformer station, performance place

Power supply for complex facilities

High-rise building, multipurpose building, apartment

Public places where fire prevention is important


Underground store, subway, hotel, hospital

Places requiring resistance against environments such as water contamination, etc.

Water treatment facility, hydro-power plant

Renewables energy

Solar photovoltaics, Wind power, etc.

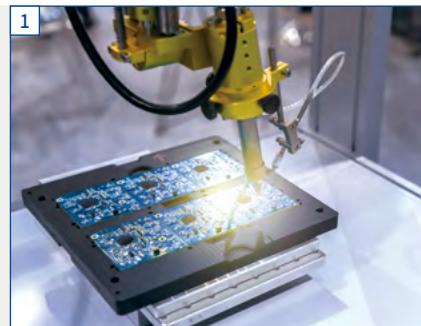

Special-purpose Cast Resin Transformer

LS Cast Resin Transformer is not only being widely used for general power distribution and power generation but is also customized conforming to customer's order specification.

* For special-purpose transformers, please contact us for more information

Ground transformer

- This is a transformer installed to supply a neutral point for grounding in power systems where it is difficult to take a proper grounding method.
- This mainly uses Wye-Delta connection or Zig-Zag connection, and is made for short time rating.

Equipment test transformer

- This is a transformer used for short circuit tests, etc. for equipment, so it deals with large currents and requires special insulation design considering transient voltages due to frequent switching

Subway power supply transformer

- Places requiring resistance against environments such as water contamination, etc.

Transformer for nuclear power plant

- This is a transformer fulfilling the characteristics(seismic, environmental) of class 1 electric equipment required by nuclear power plants.
- It is required to have a quality assurance qualification certificate required by the Korea electric power industry criterion(KEPIC).

Harmonic enduring transformer

- If a conventional transformer is used on a load that contains harmonic rather than a sine wave, it causes problems such as overheating, noise increase, etc.
- This transformer is specially designed considering Harmonic component analysis data(K-Factor) It can be applied on loads such as communication equipment, rectifier, inverter.

Ship transformer

- This is a transformer fulfilling the severe environment condition of ships that requires high reliability such as vibration resistance, salt resistance, etc.
- An AFWF(forced water cooling type transformer) technology is used considering the fact that the temperature in transformer stations is high due to the characteristics of ships.
- We have secured ship class certification such as ABS, BV, GL, DNV, KR, etc.

VVF transformer


- This is used as an input/output transformer for 6Pulse, 12Pulse, 24Pulse.

Input transformer



- This is used when the system voltage is different from the VVF input voltage or when isolation is needed.
- The input transformer isolates VVF from the system and reduces short circuit currents.
- Using an electro-magnetic shield specially designed between high and low voltage coils not only reduces harmonics generated from VVF but also reduces transient voltages introduced from the system to protect VVF.

Output transformer

- This is used when the VVF output voltage is different from the motor voltage or when isolation is needed.
- This is made as a step-up transformer in general.
- This is designed and made based on the data from the rectifier maker because output voltages contain frequency variations, harmonic components and DC components transiently.

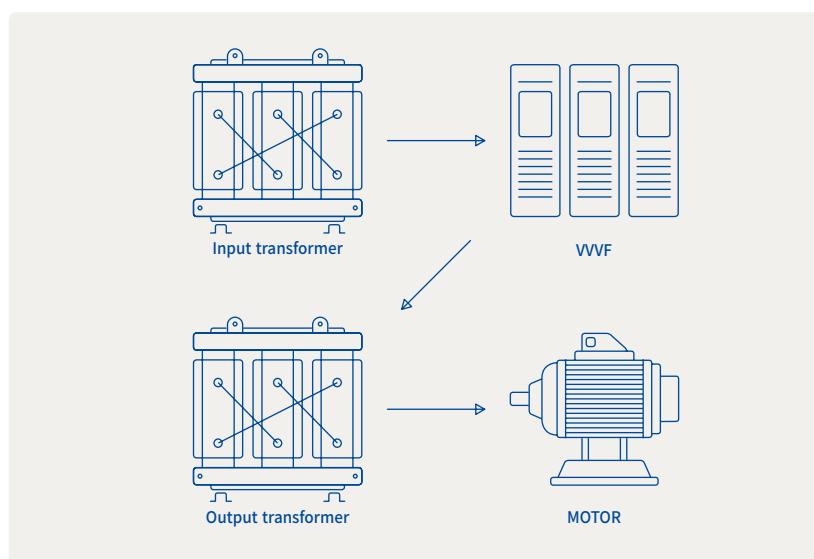

Components

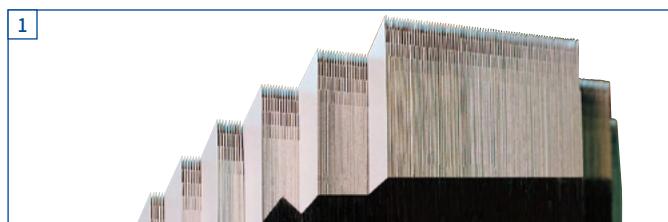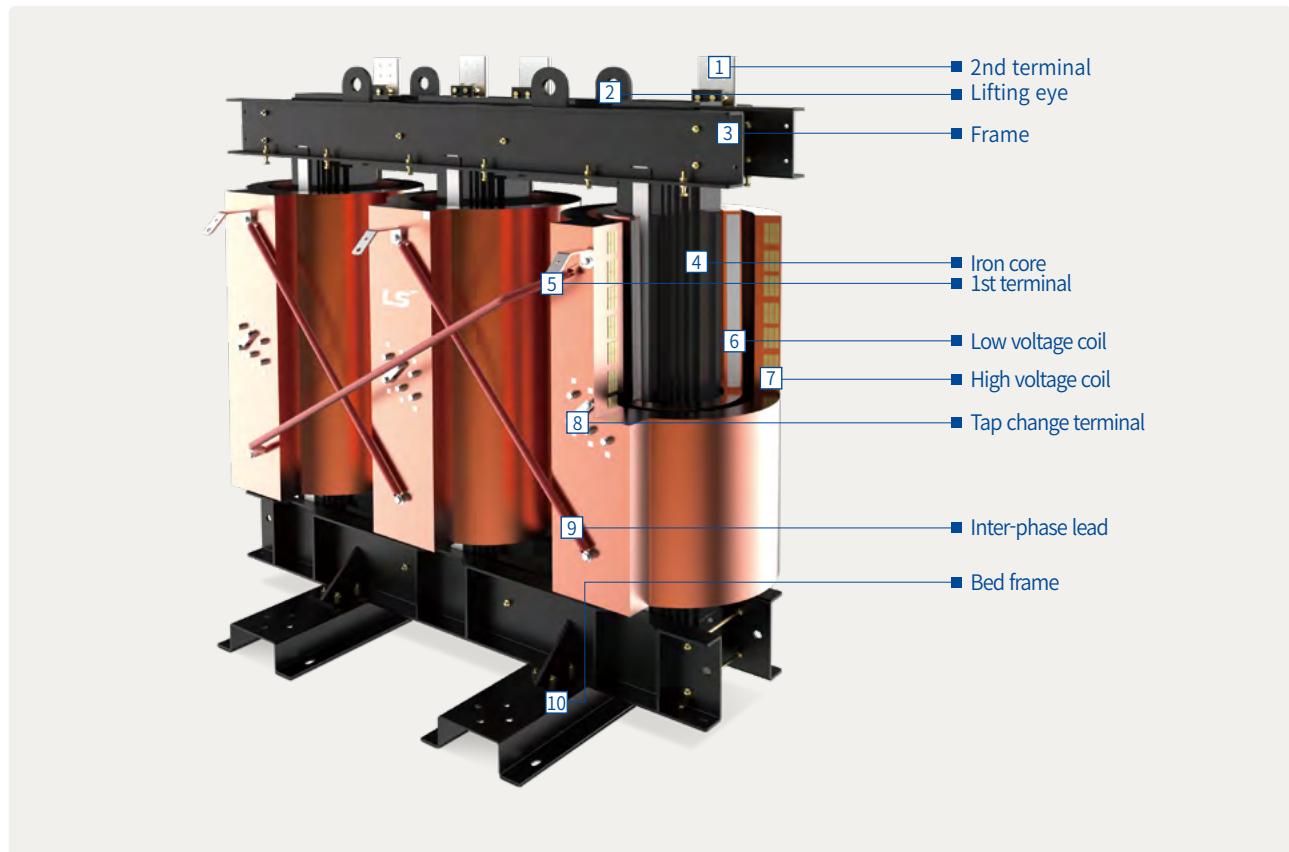

Iron core

The iron core uses cold-rolled oriented silicon steel plates of good quality and uses a step-lap method to conserve the characteristics of silicon steel plates to function in no-load loss and exciting current characteristics.

The surface of the iron core is protected by antirusting painting.

1. Step lap core
2. Core stacking
3. Core assembly



High voltage coil

This is vacuum-cast with epoxy resin with excellent mechanical and electrical performances using conductors with high conductivity to be outstanding in short circuit strength and insulation performance.

Low voltage coil

Using conductor and Prepreg insulating paper and it's casted in epoxy resin to work well in short circuit strength and humidity resistance.

1. HV coil vacuum cast type
2. LV coil encapsulated cast type
3. LV coil vacuum cast type (Optional)



Standard components



HV terminal

This is connected to the inlet cable, so please check the bolt tightening condition before inputting power.



LV terminal

This is connected to the flexible bus and cable in the low voltage load side, so please check the bolt tightening condition before inputting power.



Grounding terminal

This is attached on the bottom frame, so please check the grounding condition before inputting power.



Tap change terminal

To change the 2nd voltage of the transformer, turn off the power and adjust the tap terminal.



Danger mark

Touching the coil surface during operation of the transformer can cause danger, so please do not touch it during operation.



Lifting eye

This is attached on the top frame, so use it to lift the transformer.



Anti-vibration pad

Insert anti-vibration pad between the transformer and ground to prevent iron core vibrations from transferring to the ground during operation.



Tap change terminal cover

The conductor part of the tap terminals secures, insulation distance and improve safety.

Option components

Digital thermometer / Controller



P2-100

1 point temperature measurement, alarm, trip, fan control



P2-300M

3 points temperature measurement, alarm, trip, fan control



P2-300F

3 points temperature measurement, alarm, trip, fan control, fan fault check, fan operating time/alarm, fan step-by-step operating



P2-400

4 points temperature measurement, alarm, trip, fan control



P2-400CH

4 points temperature measurement, alarm, trip, fan control, measuring harmonic current/voltage

Cooling fan



Low noise cooling fan



Large cooling fan

Other accessories



Bidirectional wheel




Enclosure



Extension busbar



Manufacturing and quality management

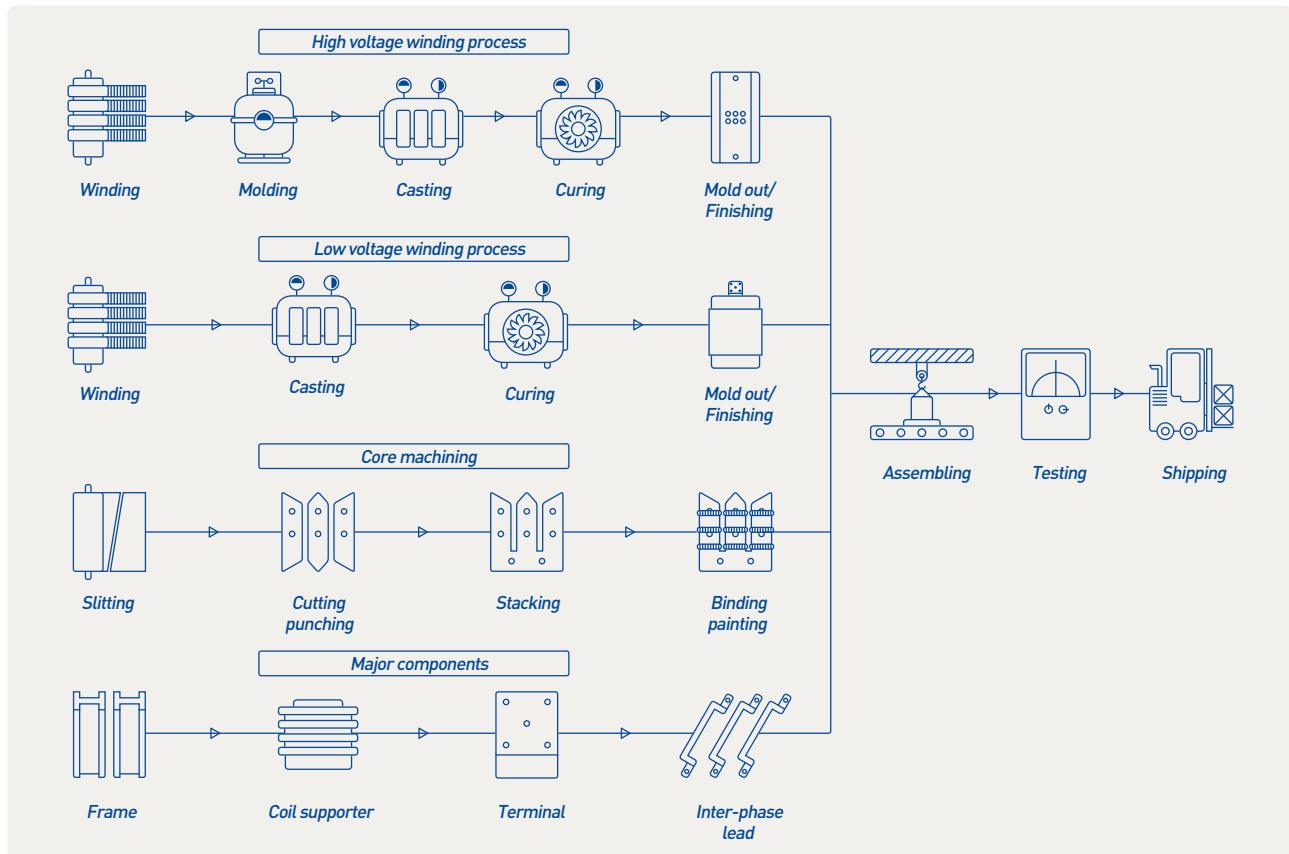

We have an authorized power test technology center, operating ISO 9001-certificates quality system and performing tests according to IEC 60076-11, IEEE C57.12.01, KSC 4311, Etc.

Routine test

We manage the quality of all transformers produced by our factory according to the ISO 9001 system, and perform tests according to National Standard.

- Structure inspection
- Coil resistance measurement
- Transformation ratio, polarity and angular displacement test
- No-load current and no-load loss test
- Load loss and impedance voltage test
- Normal frequency withstand voltage test
- Induction withstand voltage test
- Partial discharge test (10pC or less)

Type test

The type test is executed when there is a demand from customers or when changing the type of a transformer.

- Full wave lightning impulse test (LI)
- Temperature rise test

Special test

LS Cast Resin Transformer has completed the following tests during the product development stage to exert the performance of products to be used in environments.

- Short circuit test certified by KERI and PT&T
- Noise test according to IEC 60076-10, using a Pressure Level (Lp)

$$Lw(A) = Lp(A) + 10\log(S)$$

$S = 1.25 \times H \times P$

H : Transformer height

P : Length of the ellipse connecting the measurement positions

An environment resistance test was performed on LS Cast Resin Transformer according to the revised standard IEC 60076-11 at an international institution CESI(Italia) for the first time in Korea.

- Environmental test (Moisture-resistance test) Test on whether the transformer works normally in moisture/water condensation or contamination conditions at the place of use
- Climatic test (Thermal shock test) Internal crack performance test depending on rapid temperature or load changes during transportation, storage and operation
- Fire behavior test (Non-flam mability and toxic gas test) Test on self-extinguishability and whether toxic gases are generated in the case of fire

Standard specification

CAST RESIN TRANSFORMER


Division	Standard specification	
Installation place	Indoor, Outdoor with enclosure	
Applicable standard	IEC 60076-11 (or IEEE C57.12.01, JEC2200, Etc.)	
Rated frequency, fr	[Hz]	60(or 50)
Insulation System Class	F Class (or H Class)	
Limited Winding temperature rise	[k]	100 (or 125)
Highest voltag, Um, (r.m.s.)	[kV]	24
HV rated voltage, Ur	[kV]	22.8
Tapping volatge step, range	5 Taps, $\pm 2 \times 2.5\%$	
LV rated voltage, Ur	[V]	380
Connection symbol	Dyn1 (or Dyn11, Dd0, YNd1, Etc.)	
Full wave lightning impulse voltage (HV/LV)	[kV]	95 / - 125 / -
Applied voltage (HV/LV)	[kV]	50 / 3
Rated Power, Sr	[kVA]	300 500 600 650 1000 1500 1800 2000 2500
Enclosure	IP 2X, IP 3X, IP 4X	

* The above descriptions are standard specifications, but other specifications are available according to orders. (~36kV, ~25MVA)

Metasol

Compact design and reasonable solution

Standard : IEC 60076-11

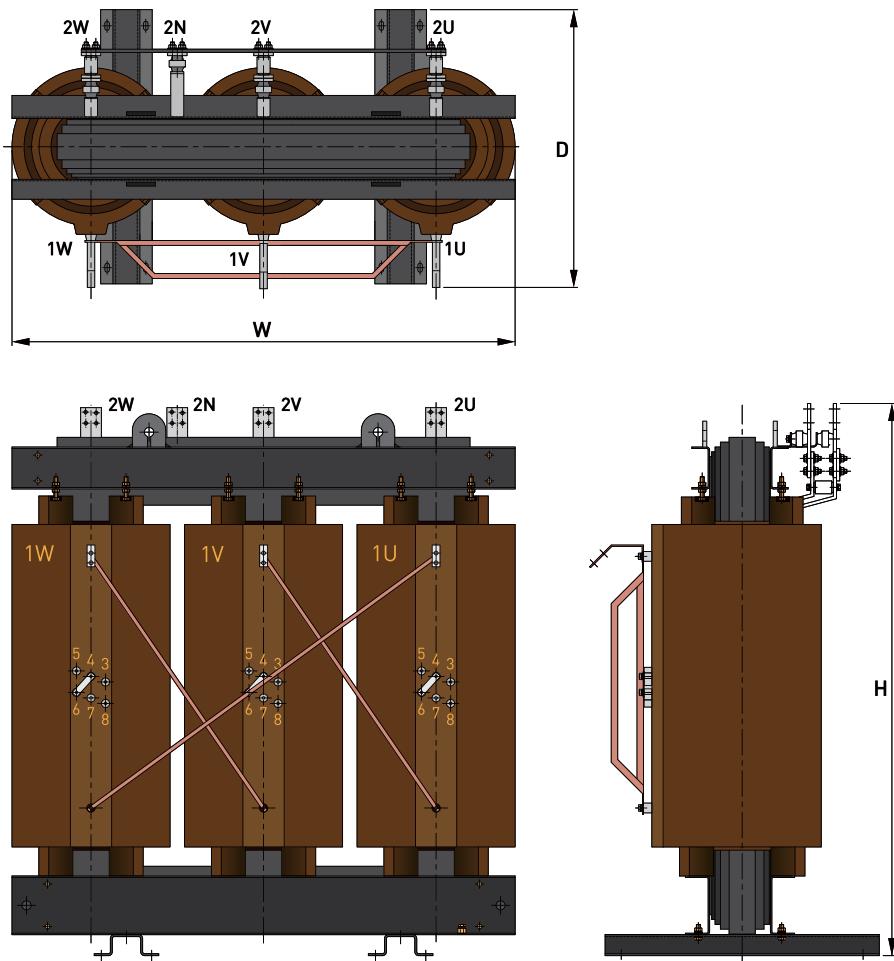

Rated voltage(Ur): 22 kV/380V

Rated power (kVA)	Impedance voltage: uK (%)	No-load loss: P0 (W)	Load loss: PK (W)	Efficiency (%) at 120°C			Exciting current: IO (%)	Voltage regulation (%)	Sound level: LpA (dB)	Dimension (mm)				Weight (kg)
				at 120°C	100% Load	50% Load				Width (W)mm	Depth (D)mm	Height (H)mm	Height+ Wheels mm	
300	6	1,000	4,500	98.0	98.5	0.9	2.0	64	1,250	800	1,500	1,515	1,100	
500	6	1,600	7,500	98.0	98.5	0.9	1.8	64	1,385	900	1,655	1,670	1,550	
600	6	1,700	6,000	98.6	98.8	0.9	1.5	64	1,430	900	1,650	1,665	1,800	
650	6	1,800	8,000	98.4	98.7	0.9	1.5	64	1,485	900	1,665	1,680	1,850	
1,000	6	2,500	11,000	98.6	98.9	0.7	1.3	65	1,665	1,000	1,865	1,880	2,800	
1,500	6	2,550	11,500	98.7	99	0.7	1.1	67	1,740	1,000	1,810	1,865	3,200	
1,800	6	3,700	13,800	98.8	99.1	0.6	1.0	68	1,845	1,200	2,100	2,215	4,300	
2,000	6.5	3,700	16,700	98.8	99.1	0.5	1.0	68	1,845	1,200	2,100	2,215	4,300	
2,500	6.5	4,900	19,000	98.9	99.1	0.5	0.9	70	2,015	1,200	2,120	2,235	5,250	
3,200	7	6,050	21,500	99.0	99.2	0.9	1.0	65	2,295	1,400	2,170	2,285	6,700	

"Pre-inspection and maintenance are essential to increase the lifespan and efficiency of the product." "Please follow the recommendation instruction below for the simple maintenance of our cast resin transformer."

Checkpoints when installing cast resin transformers

Installation condition

- The installation place shall be clean, free from flooding and falling water from the ceiling.
- The installation place shall have a ventilation structure to ventilate the heat generated from the transformer.

The vinyl packing for prevention of foreign substances such as dust, screws, nuts and washers from invading shall be maintained until power is input after installation.

Checking of cast resin transformers that are in a long-term storage condition

- If dust is accumulated after long-term storage of cast resin transformers, then remove dust using a vacuum cleaner or blow out dust with compressor and wipe out dust using a dry cloth. (too many using a, Rephrase).


Torque values for connecting with low voltage terminals

Bolt	M8	M10	M12	M16
Torque	125	250	405	1,500


Unit : kgf·cm

Caution when connecting the terminals

When connecting cables or bus-bars to the HV, LV terminals, avoid mechanical stresses to the HV, LV terminals, and especially when connecting bus-bars, use flexible bus-bars by all means to reduce mechanical stresses due to transformer vibrations. Connecting bus-bars directly to the HV, LV terminals can loosen the connection parts or cause abnormal noises due to transformer vibrations during operation.

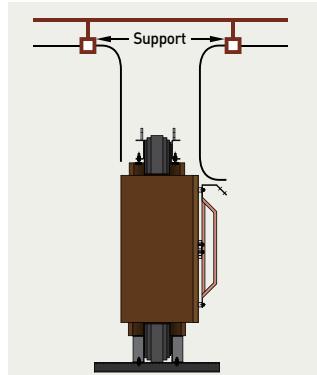

Top cabling (Cable)

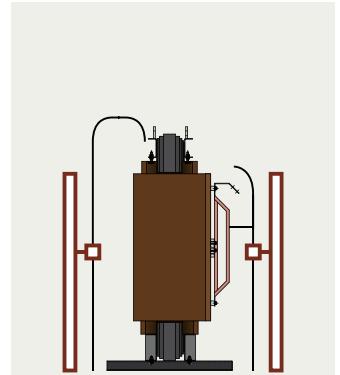

Bottom cabling (Cable)

How to minimize transformer noises when installing transformers

- Install cushion rubber beneath the bed frame.
- When installing transformers, separate them mechanically from their enclosures to prevent vibrations of the enclosures.
- When connecting terminals, use flexible busbars.
- The transformer installation places shall be rigid and maintain horizons well.
- Large-capacity transformers shall be installed near pillars of the building to reduce vibrations.
- Avoid corners of the wall for installation.
- Install non-flammable sound-absorbing materials inside the panels if necessary.

Installation and operation conditions

Considerations for ventilation

Height and area of the vent

- In the case of natural cooling, ventilation of the enclosure shall discharge the heat generated from total heat loss of the transformer via natural convection.
- Proper ventilation is realized by the inflow of cold air from the inlet A and the outflow of hot air through the outlet A' located at a height H.


$$A = \frac{HL}{0.1 \sqrt{H\Delta\theta a^3}} \text{ (m}^2\text{)}$$

$$A' > A \times 110\% \text{ (min.)}$$

A : Required inlet area (m^2)
A' : Required outlet area (m^2)
 $\Delta\theta$: Air temperature rise (K) = 15K (Approximate value)
HL : Heat loss (kW)
H : Distance from the center of the outlet and the center of the TR (m)

Forced ventilation

- When the average ambient temperature is higher than 20°C or the transformer is often operated in an overload condition, forced ventilation using fans is necessary if the vent area is less than the standard.

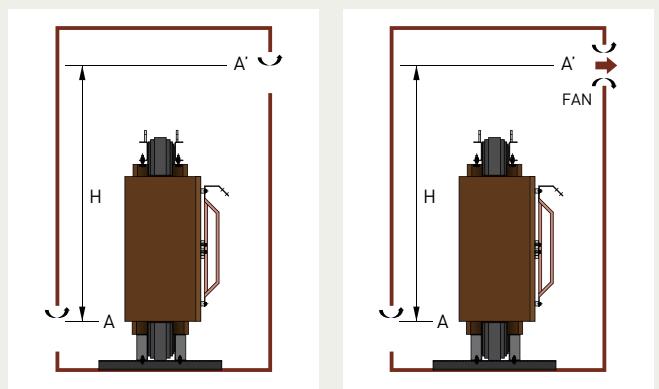

Minimum insulation distance

- Epoxy resin surface
- Ground
- Insulation-reinforced inter-phase lead surface
- Insulation cable

Checkpoints before receiving power

- Remove the packing vinyl cover and check the wiring condition, isolation distance, foreign substance residuals, component breakage, bolt torque, etc.
- Compare the connecting inter-phase leads of cast resin transformer with vector diagram on name plate.
- Measure the insulation resistance using a DC1000V insulation tester(Megger).

Highest voltage (kV)	BIL (kV)	Minimum clearance (mm)	
		Active - Earthed	Surface of epoxy Resin - Earthed
≤1.1	-		10
3.6	40	60	50
7.2	60	90	50
12	75	120	75
17.5	95	160	100
24	125	250	150
36	170	350	200


Maintenance / Repair

Environment for general use

Remove dust using a vacuum cleaner and blow out the over-accumulated dust using a dry compressor every year. The cleaning period can differ depending on the use environment. During maintenance work, check the bolt mounting conditions using a torque wrench.

How to request A/S

In case transformer related A/S is necessary, identify the serial number on the nameplate of cast resin transformer and the exact condition for quick and proper A/S.



Global Network

LS has expanded its business all around the world
Our global network includes 9 overseas corporations,
13 overseas branches, in 12 countries.



► R&D



R&D Campus

Focuses on gaining competitive advantages through development of next generation platforms



Power Device R&D Center

Leading technology in electric industry and continuously developing future-growth dynamic engines



Automation R&D Center

Serves as the main research institute for LS



PT&T (Testing laboratory)

Internationally-renowned testing center that has formed partnerships with the UL, CE, KEMA and CESI

► Factory



Cheongju Factory (Korea)

Electric products, mold TR, MV/LV switchgear, HV GIS



Cheonan Factory (Korea)



Busan Factory (Korea)



Wuxi Factory (China)

Electric products



Dalian Factory (China)

MV/LV switchgear, MV contactor



Hanoi Factory (Vietnam)

MV/LV switchgear, Mold TR

PLC, AC drive, HMI, DCS, PV module

HV TR, HVDC, FACTS

Electric products

MV/LV switchgear, MV contactor

MV/LV switchgear, Mold TR

**Headquarter**

127 LS-ro (Hogye-dong) Dongan-gu, Anyang-si, Gyeonggi-Do, 14119, Korea

Seoul Office

LS Yongsan Tower, 92, Hangang-daero, Yongsan-gu, Seoul, 04386, Korea

TEL: 82-2-2034-4916, 4684, 4429

China

LS ELECTRIC (Dalian) Co., Ltd.

+86-411-8730-5872

china.dalian@iselectric.com.cn

LS ELECTRIC (Wuxi) Co., Ltd.

+86-510-6851-6666

china.wuxi@iselectric.com.cn

LS ELECTRIC (Lishui) Co., Ltd.

+86-578-6866-780

china.lishui@iselectric.com.cn

Shanghai Office

+86-21-5237-9977

china@iselectric.com.cn

Beijing Office

+86-10-5095-1631

china@iselectric.com.cn

Guangzhou Office

+86-20-3818-2883

china@iselectric.com.cn

Qingdao Office

+86-532-8501-2065

china@iselectric.com.cn

Chengdu Office

+86-28-8670-3201

china@iselectric.com.cn

Nanjing Office

+86-25-84 67-0005

china@iselectric.com.cn

India

India Office

+91-80-6142-9108

Info_India@ls-electric.com

Indonesia

PT. LS ELECTRIC INDONESIA

+62-21-2933-7614

indonesia@ls-electric.com

PT SYMPHOS ELECTRIC

+62-81-1900-1474

marketing@symphos-weltraf.com

Italy

Italy office

+39-030-8081-833

italia@ls-electric.com

Japan

LS ELECTRIC Japan Co., Ltd.

+81-3-6268-8241

japan@ls-electric.com

Tokyo Office

+81-3-6268-8241

tokyo@ls-electric.com

Netherlands

LS ELECTRIC Europe B.V.

+31-20-654-1424

europartner@ls-electric.com

Russia

Moscow Office

+7-499-682-6130

info@iselectric-ru.com

Singapore

Singapore Office

+65-6958-8162

singapore@ls-electric.com

Spain

LS ELECTRIC IBERIA S.L.U.

+34-910-28-02-74

iberia@ls-electric.com

Thailand

Bangkok Office

+66-2-128-0295

thailand@ls-electric.com

Türkiye

LS ELECTRIC Türkiye Co., Ltd.

+90-212-806-1252

turkiye@ls-electric.com

U.A.E

LS ELECTRIC Middle East FZE (Dubai)

+971-4-886-5360

middleeast@ls-electric.com

USA

LS ELECTRIC America Inc.

+1-800-891-2941

sales.us@iselectricamerica.com

LS ENERGY SOLUTIONS LLC

+1-980-221-0654

info@ls-es.com

MCM Engineering II

+1-435-865-0125

sales.us@iselectricamerica.com

America Western Office

+1-949-333-3140

america@ls-electric.com

America Bastrop Campus

+1-800-891-2941 EXT 2

power_support.us@iselectricamerica.com

Vietnam

LS ELECTRIC Vietnam Co., Ltd.

+84-222-2221-110

vietnam@ls-electric.com

Hanoi Office

+84-24-6275-8054

vietnam@ls-electric.com

Ho Chi Minh Office

+84-3823-7890

vietnam@ls-electric.com